




2013 CPC 1211.5

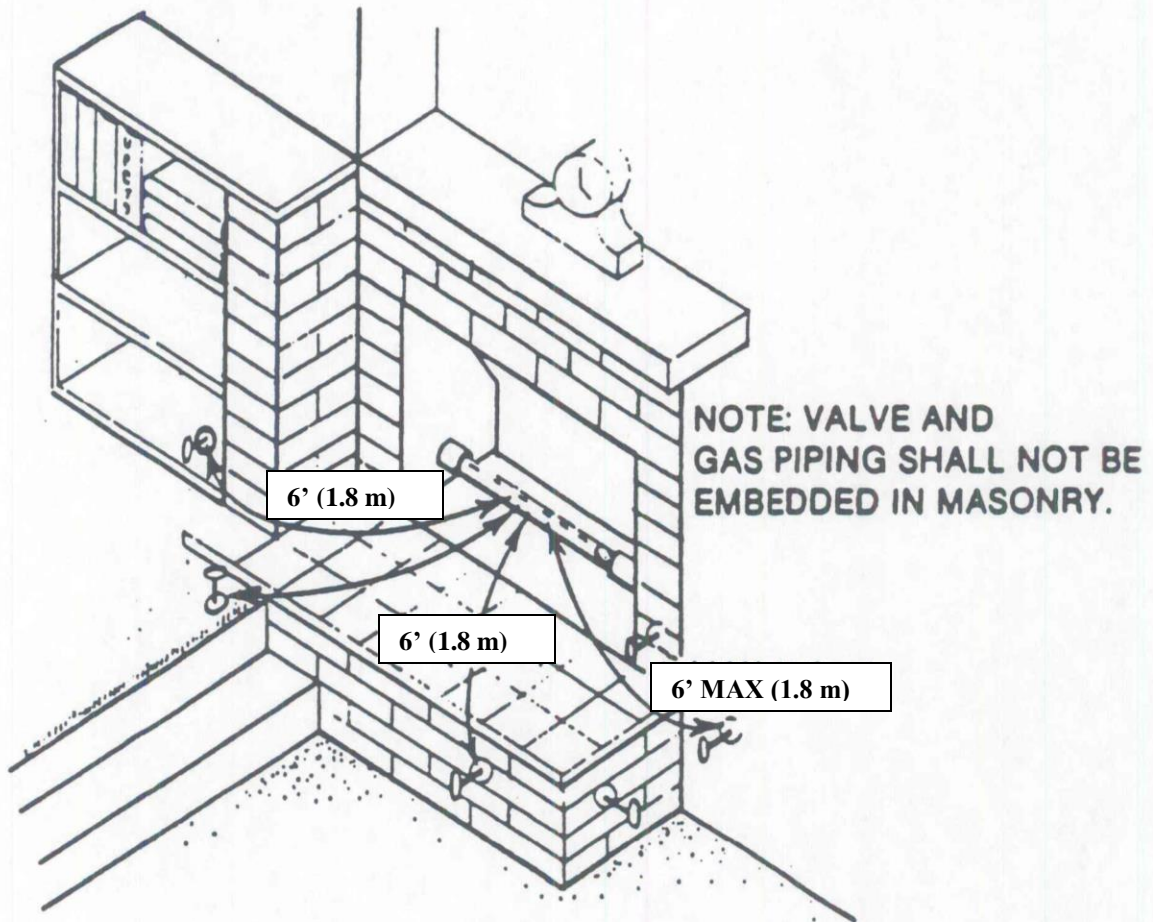

All gas outlets located in a barbecue or fireplace shall be controlled by an approved operating valve located in the same room and outside the hearth, but not more than six (6) feet (1.2 m) from such outlets. When piping on the discharge side of any such control valve is standard weight brass or galvanized steel, such piping may be embedded in or surrounded by not less than two (2) inches (50.8 mm) of concrete or masonry